


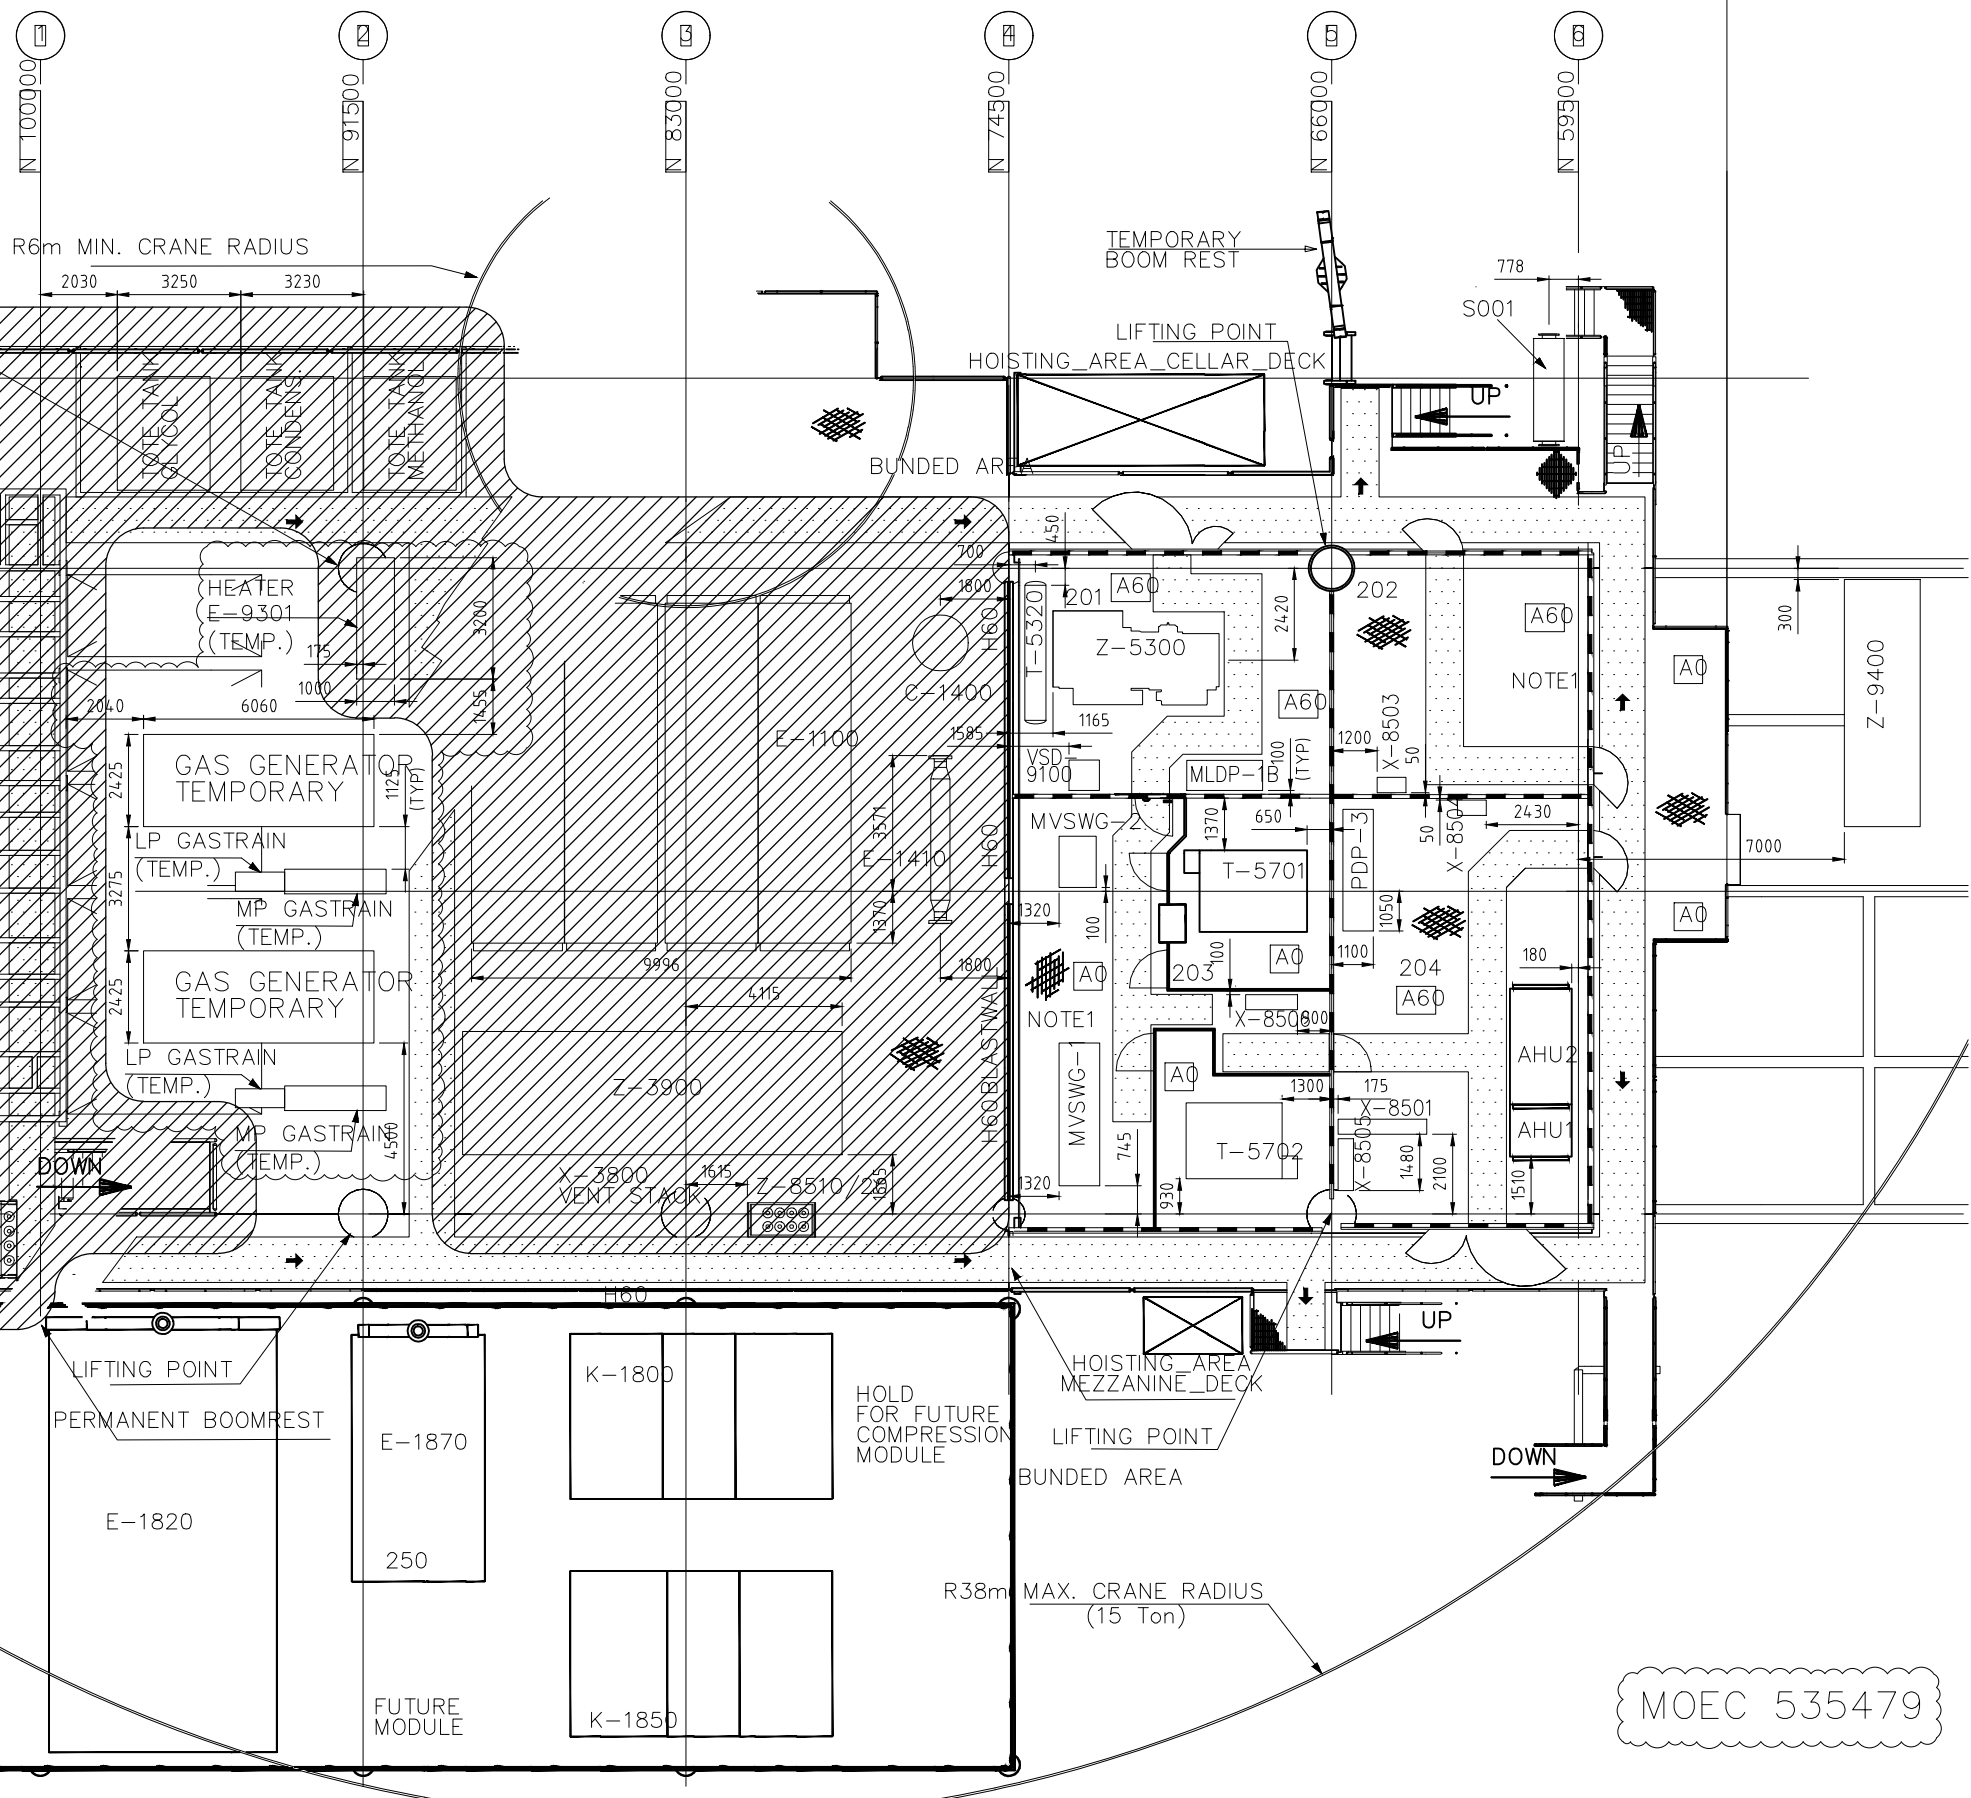


## NOTES

1. AREA CLASSIFICATION IS BASED ON NEN-EN-IEC 60079-10-1.
2. PLATFORM IS DESIGNED & BUILT TO HAVE WIND WALLS. THE VENTILATION IS CONSIDERED AS "NATURAL & FAIR" FOR EX CLASSIFICATION SCHEDULE.
3. DURING DRILLING WORK OVER ACTIVITIES ZONE 1 WILL BE APPLICABLE AS SHOWN, OTHERWISE ZONE 2 IS APPLICABLE.
4. OUTSIDE THE LIVING QUARTER AREA ALL EQUIPMENT SHALL BE SUITABLE FOR ZONE 2, IIA, T3.
5. EQUIPMENT LOCATED INSIDE BATTERY ROOM SHALL BE SUITABLE FOR ZONE 2, IIC, T3 AREA CLASSIFICATION. H2 GAS DETECTORS SHALL BE PROVIDED IN BATTERY ROOM (MINIMUM 2 NOS).
6. RIG CONNECTION PROVISION & TEMPORARY GENERATOR SET CONNECTION BOX, WHEN LOCATED IN CLASSIFIED AREA, SHALL BE SUITABLE FOR ZONE 2, IIA T3 AREA CLASSIFICATION.
7. WHOLE I/Q ALONG WITH MV SWITCHGEAR ROOM, EMERGENCY GENERATOR & SWITCHGEAR ROOM, MCC ROOM & INSTRUMENTATION ROOM ARE AS NON CLASSIFIED (SAFE) AREA.
8. FUTURE COMPRESSOR MODULE AREA ZONE CLASSIFICATION IS NOT SHOWN/CONSIDERED.
9. VENT STACK HAZARDOUS ZONE RADIUS SHOWN AT 1 METER.
10. REFER TO HAZARDOUS AREA CLASSIFICATION LIST IN05A-2-30-0-2153-01 FOR ZONE EXTENT CALCULATION METHODES AND CODES.
11. HP/LP ZONE RADIUS IS BASED UPON EBD CASE.

**HOLDS**

- 1. BATTERY ROOM EXHAUST FANS LOCATION.**

## LEGEND



## ZONE 0



## ZONE 1




## ZONE 2

## REFERENCE DRAWINGS

| DRAWING NUMBER       | DESCRIPTION                                                   |
|----------------------|---------------------------------------------------------------|
| N05A-2-30-0-21513-01 | HAZARDOUS AREA CLASSIFICATION LIST                            |
| N05A-5-52-0-5300-01  | HAZARDOUS AREA CLASSIFICATION CELLAR DECK T.O.S. EL.+22300    |
| N05A-5-52-0-5300-02  | HAZARDOUS AREA CLASSIFICATION MEZZANINE DECK T.O.S. EL.+26300 |
| N05A-5-52-0-5300-04  | HAZARDOUS AREA CLASSIFICATION HELI DECK T.O.S. EL.+34750      |
| N05A-5-52-0-5300-05  | HAZARDOUS AREA CLASSIFICATION LOOKING EAST                    |
| N05A-5-52-0-5300-06  | HAZARDOUS AREA CLASSIFICATION LOOKING SOUTH                   |
|                      |                                                               |
|                      |                                                               |
|                      |                                                               |
|                      |                                                               |
|                      |                                                               |

## KEYPLAN

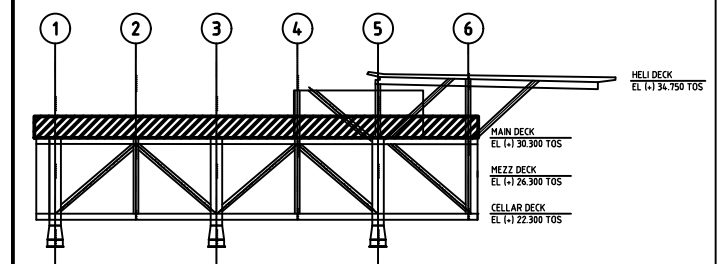

|               |               |    |      |                          |             |            |             |
|---------------|---------------|----|------|--------------------------|-------------|------------|-------------|
| 06            | 46            | 09 | 2022 | ISSUED FOR COMMENTS      | MMA         | MAL        | WDG         |
| 03            | 29            | 11 | 2019 | REQUESTED FINAL FOR FEED | PAT         | HAM        | MST         |
| 02            | 19            | 11 | 2019 | FINAL FOR FEED           | MKA         | PAT        | MST         |
| 05            | 01            | 12 | 2022 | ISSUED FOR APPROVAL      | MMA         | MAL        | WDG         |
| ISSUE REV     | DD            | MM | YYYY | REVISION DESCRIPTION     | DESIGNED BY | CHECKED BY | APPROVED BY |
| ENGINEERED BY | REVISION DATE |    |      |                          |             |            |             |
|               |               |    |      | SCALE 5                  | 100         | PAPER SIZE | A1          |

This document is confidential. The copyright is vested in ONE-Dyns B.V., Amsterdam, the Netherlands. All rights reserved. Neither the whole nor any part of this document may be disclosed to any third party or reproduced, stored in any retrieval system or transmitted in any form or by any means electronic, mechanical, reprographic, recording or otherwise without the prior written consent of the copyright owner. 2019.

HAZARDOUS AREA CLASSIFICATION LAYOUT  
MAIN DECK  
T.O.S. EL.+30300

|           |          |              |        |                 |          |          |
|-----------|----------|--------------|--------|-----------------|----------|----------|
| ASSETCODE | DISC.CDE | DOC.TYPE CDE | PREFIX | DOCUMENT NUMBER | SHEET NR | REVISION |
| N05       | 5        | 52           | 0      | 53000           | 03       | 05       |

SIZE A1

**MAIN DECK**  
**T.O.S. +30300**

|           |    |    |               |                                 |          |             |
|-----------|----|----|---------------|---------------------------------|----------|-------------|
| 05A       | 05 | 10 | 2024          | MOEC GAS ENGINE PLACEMENT N05-A | MHS      | Michel      |
| ISSUE REV | ED | MM | YYYY          | REVISION DESCRIPTION            | DRAWN BY | CHECKED BY  |
|           |    |    | REVISION DATE |                                 |          | APPROVED BY |
|           |    |    |               | N05-A MOEC 535479               |          |             |



ONE-Dyas B.V.  
Amsterdam