


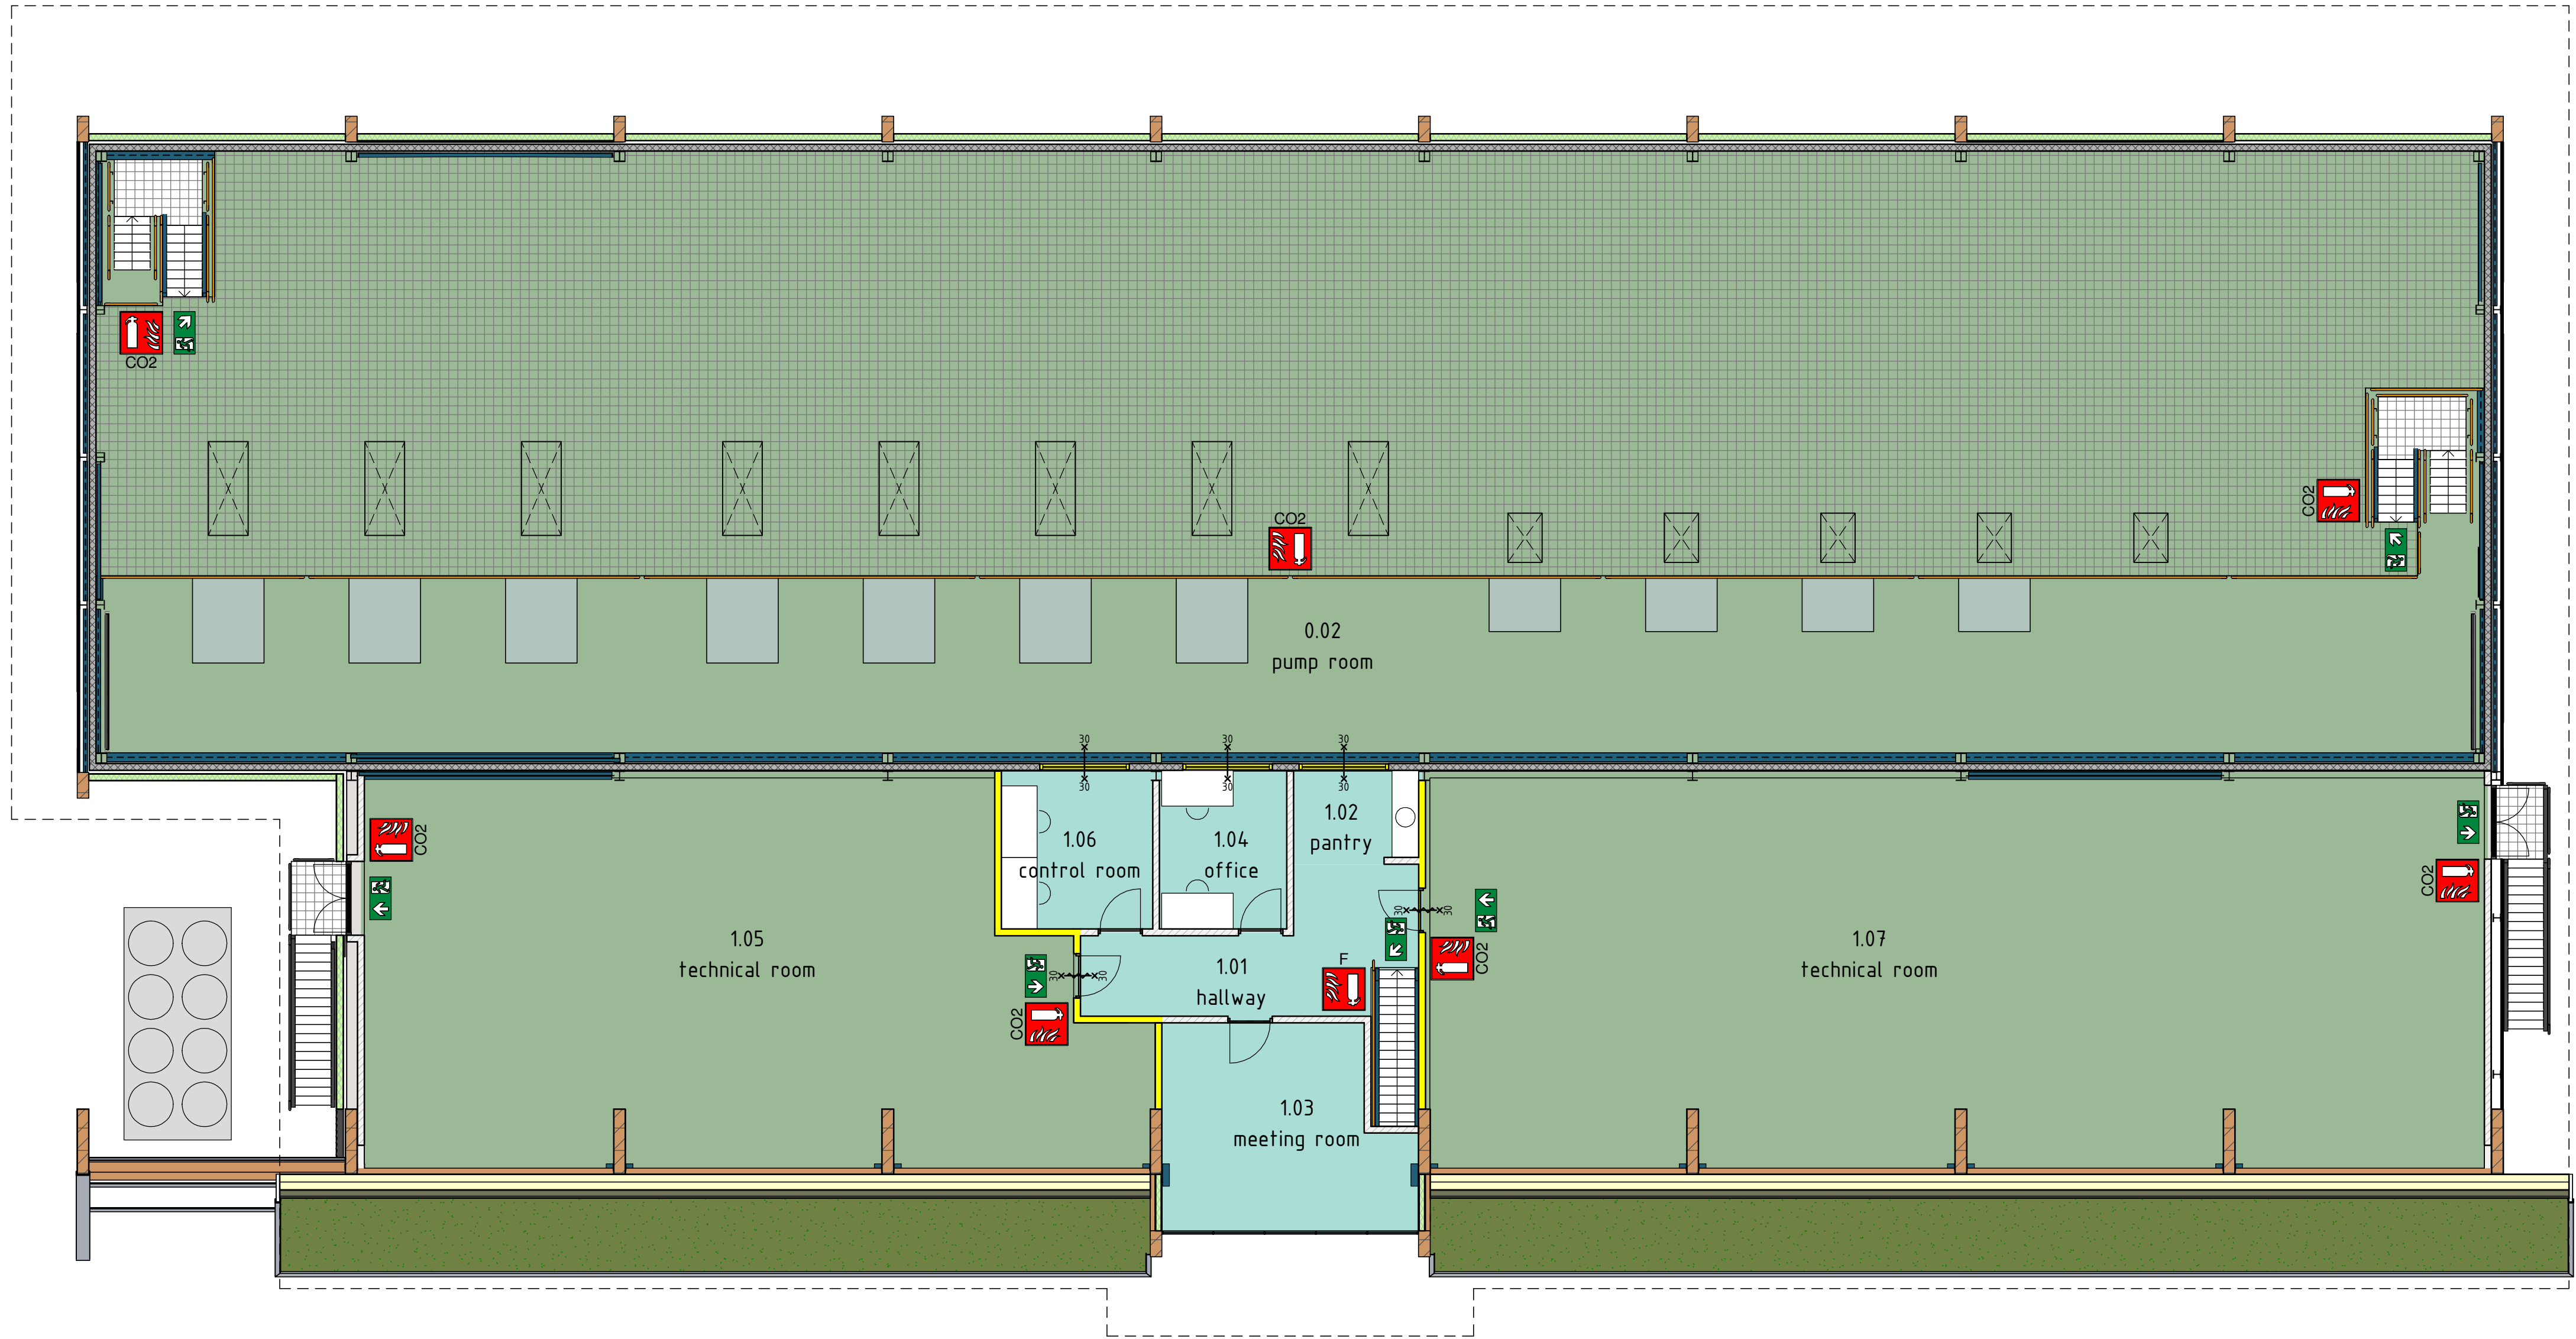

Fire safety


- double-sided fireproof, 30 of 60 minutes
- self-closing
- wdbbo 30 minutes
- wdbbo 60 minutes
- eye wash
- CO2 fire extinguisher
- foam fire extinguisher
- escape route marking

All fire compartments, wdbbo 60 min.

- fire compartment 1
 - fire compartment 2
 - fire compartment 3
 - fire compartment 4
- all small E-rooms wdbbo 60 min.

Peil = 24mtr + NAP

0m 1m 2m 3m 4m 5m

Worley energy chemicals resources				Worley Number: NR1038/C.01/0049 Client Number: 1.333.106				
B	2021-05-31	For Building Permit		5.1				
A	2021-04-01	Draft		5.1				
Rev.	Issue Date	Revision Description			Prepared by	Checked by	Disc Appr by	Proj Appr by
fact. no.	fact. dpt	processgr./-unit	itemcode/tag no.	project no.	A1	size	higher reference doc. no.	part no.
title: PUMP BUILDING								
Fire safety, 1st floor (+4000 P)								
fact./fact. deph: Nobian Industrial Chemicals B.V.								
project: Brine Field Haaksbergen								
scale	dimensions in	Am. proj.	separate partlist	doc. type	abbr.	location doc. no.		
1:100	mm			12	DAR			
 Nobian Industrial Chemicals B.V. © Nobian PO Box 25, 7550GC Hengelo, The Netherlands				size	doc. no.		sh.	
				A1 - 1.333.106				